

CONSULTANT + NAME

SURGERY CENTER

ROCHESTER HILLS, MICHIGAN

PROJECT + INFORMATION

19-407


ISSUE + DATE

15 APR 2020 SITE PLAN
15 JUNE 2020 RESUB
15 OCT 2020 RESUB

SHEET + TITLE
PHOTOMETRIC PLAN

SHEET + NUMBER
PH1.00

Schedule														
Symbol	Label	QTY	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens per Lamp	Lumen Multiple	LLF	Vattage	Efficiency	Distribution
□	A	1	Lithonia Lighting	DSX2 LED P3 30K T9	DSX2 LED P3 30K TFTM MVOLT with houseline shield	LED	1	DSX2_LED_P3_30K_TFTM_MVOLT_HS.xlsx	20478	1	1	217	100%	TYPE III, VERY SHORT, BUG RATING: B2 - U0 - G4
□	B	3	Lithonia Lighting	DSXI LED P4 30K T9	DSXI LED P4 30K TSM MVOLT	LED	1	DSXI_LED_P4_30K_TSM_MVOLT.xls	13963	1	1	250	100%	TYPE VS, SHORT, BUG RATING: B4 - U0 - G2
○	C	6	Gothan Architectural Lighting	EV04 30/02 AR WD	EV04 4IN ROUND DOWNLIGHT, 80 CRI, 3000K, 250LM, WIDE DIST, CLEAR MATTE DIFFUSE		1	EV04_30_02_AR_WD_Ldles.xls	200	1	1	31	100%	DIRECT, SC-100, SC-32, SC-90-132
□	D	2	Lithonia Lighting	DSXI LED P9 30K T9	DSXI LED P9 30K TSW MVOLT with houseline shield	LED	1	DSXI_LED_P9_30K_TSW_MVOLT_HS.xls	17449	1	1	241	100%	TYPE III, SHORT, BUG RATING: B3 - U0 - G3
□	E	2	Lithonia Lighting	DSXW2 LED 30K 1000	DSXW2 LED WITH 3 LIGHT ENGINES, 30 LED's, 1000mA DURALUX, 3000K, LED TYPE FORWARD THROW MEDIUM OPTIC	LED	1	DSXW2_LED_30K_1000_30K_TFTM_MVOLT.xls	10355	1	1	109	100%	TYPE IV, SHORT, BUG RATING: B2 - U0 - G2

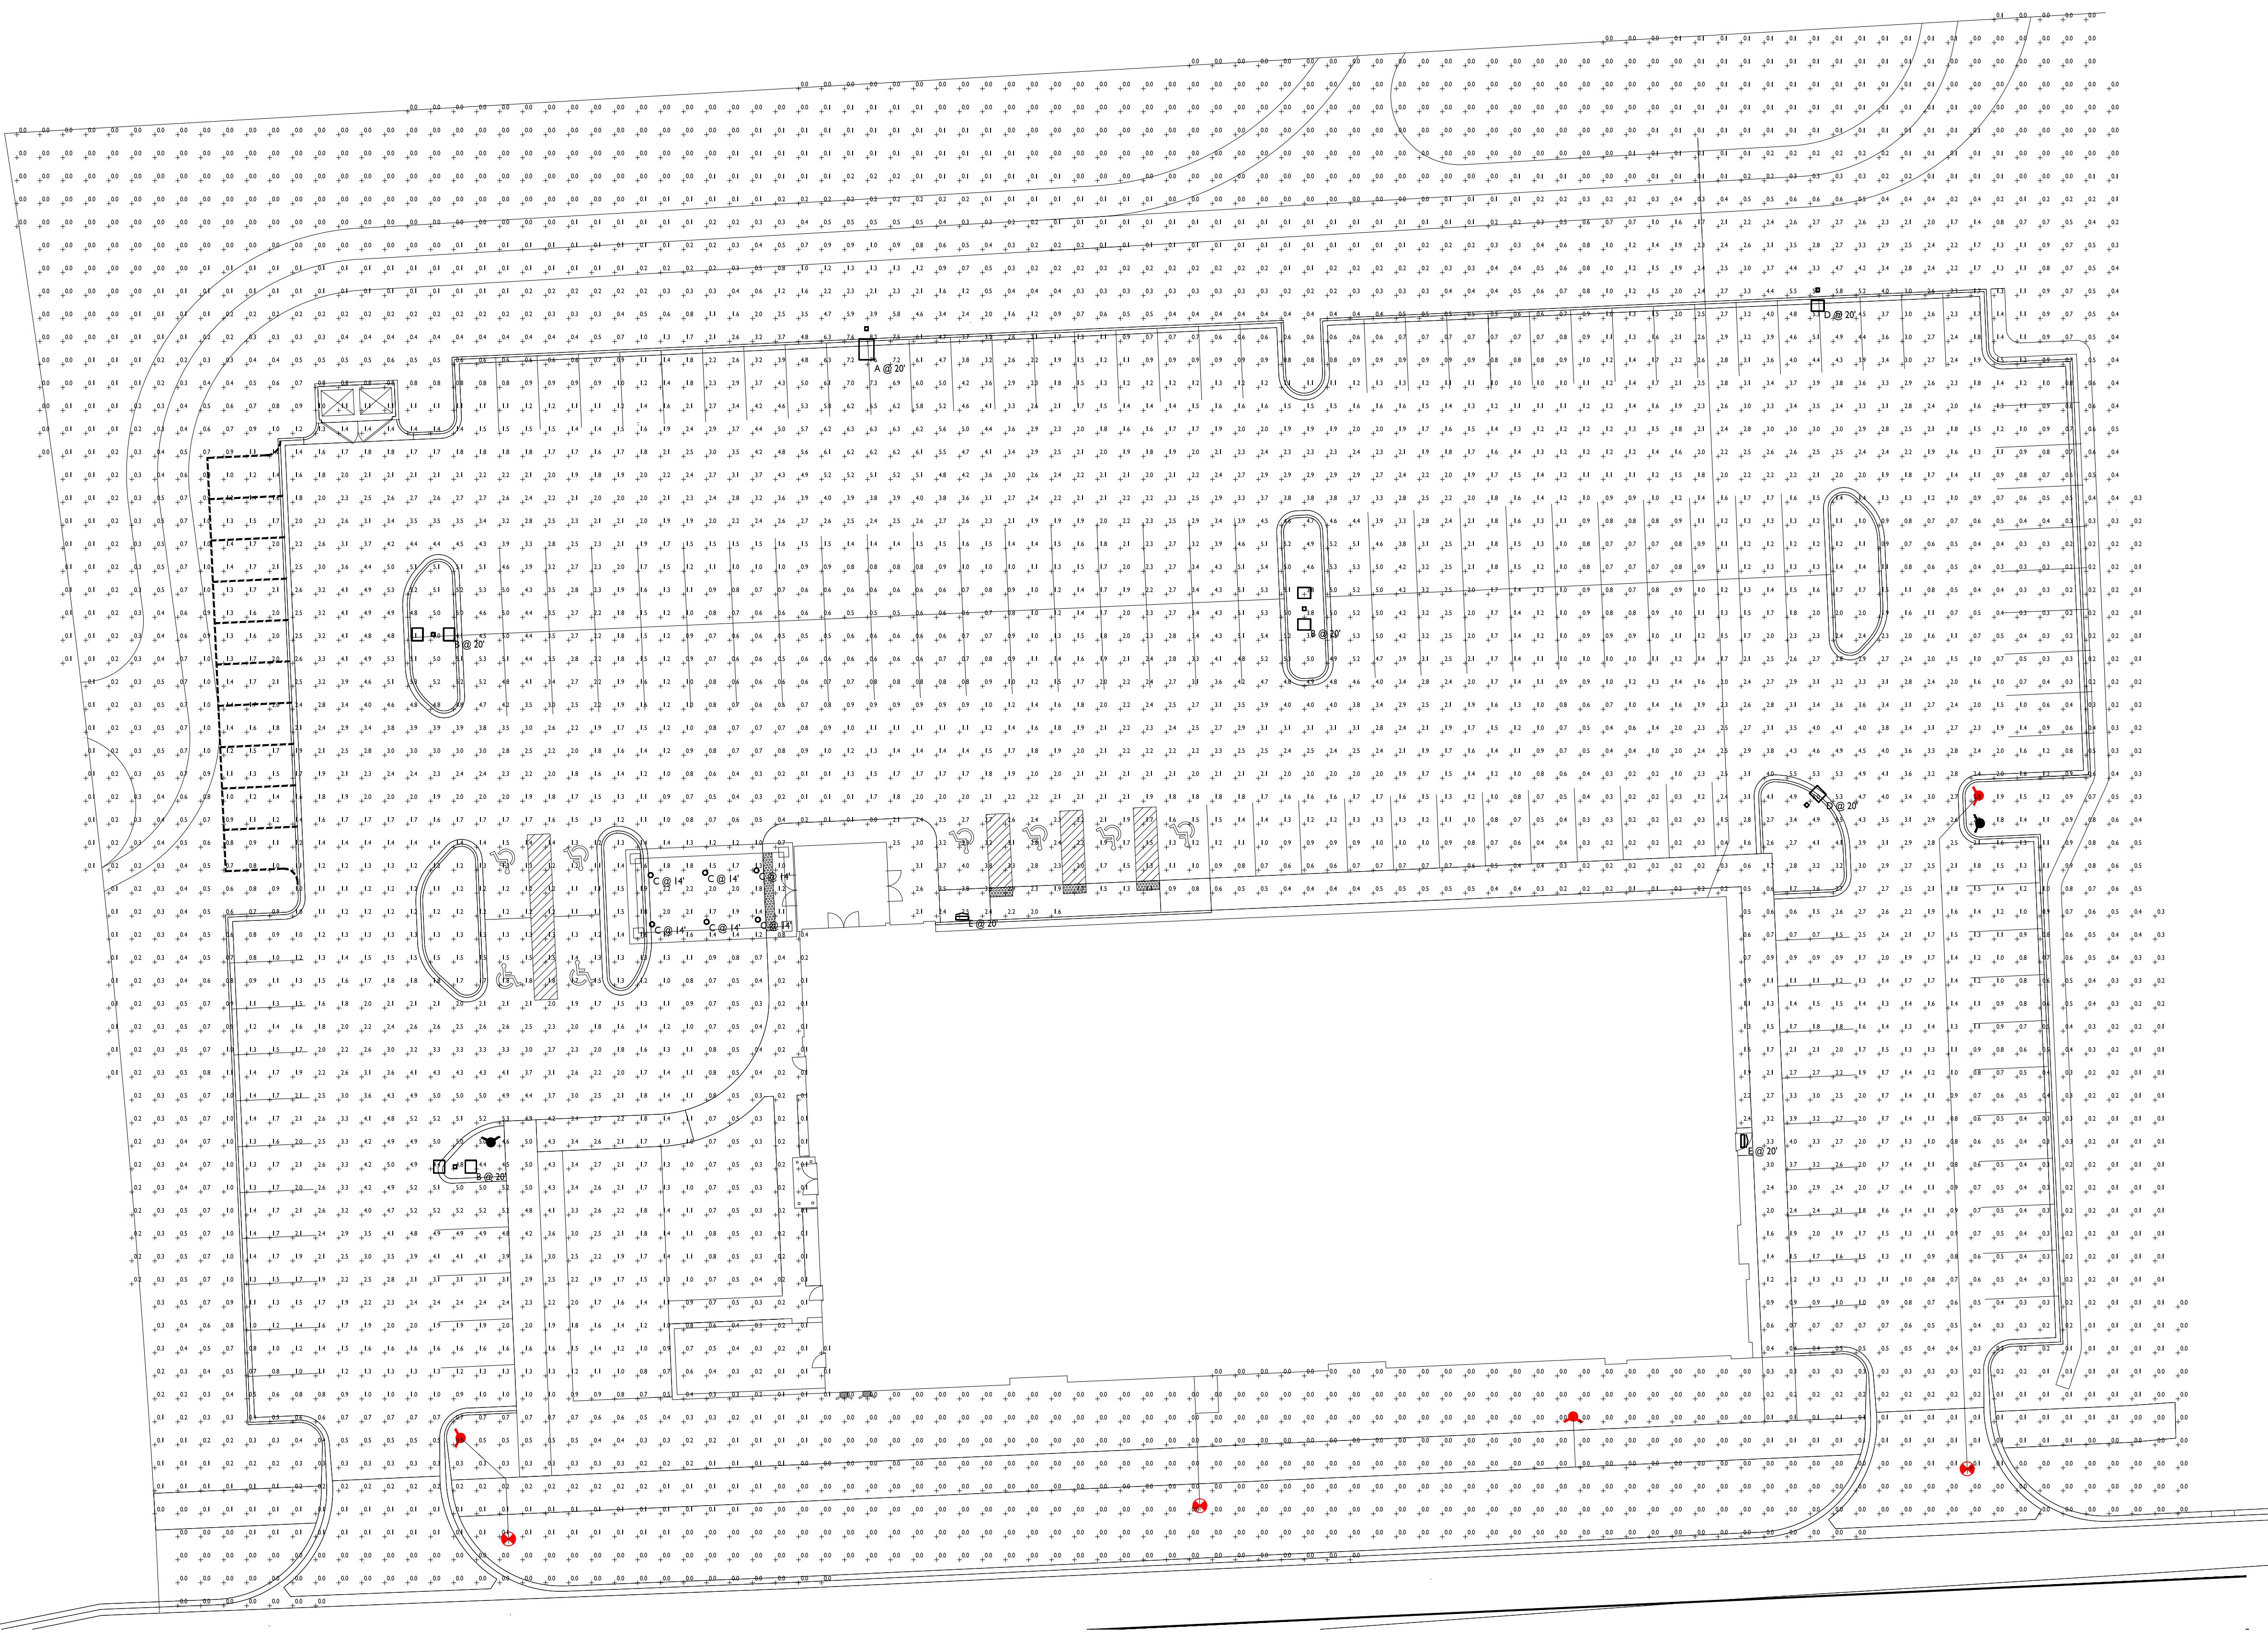

PHOTOMETRIC PLAN
SCALE: 1' = 20'

Statistics					
Description	Symbol	Avg	Max	Min	Max/Min
Overall Site	+	1.2 fc	8.2 fc	0.0 fc	N/A
Parking Area	+	2.0 fc	8.2 fc	0.1 fc	82.01

20.01

